

KEY


1. Post
Coated galvanised rectangular hollow section.
dimension: 1000 x 132 x 60mm.
rectangular profile 16 x 60mm.
finish: Micaceous iron oxide paint mid grey, minimum 3 coats
2. Lock mechanism (to be agreed with EA)
3. Gate Panel
Coated galvanized metal
dimension: 3232 x 1025 x 60mm.
Rectangular profile 8 x 60mm vertical bars and rectangular profile 16 x 60mm frame.
finish: Micaceous iron oxide paint mid grey, minimum 3 sprayed coats
4. Core bore fixing to wall with epoxy resin fixing.
5. Concrete wall.

NOTES


Balustrade & Gate to be constructed to meet the requirements of Park K Building Regulations. Minimum horizontal imposed loads for balustrades in accordance with BS6399 type C5: 3.0 KN/m² horizontal uniformly distributed line load and 1.5 KN/m² uniformly distributed load applied to the infill.

All exposed edges to be free of sharp arises.
To be read in conjunction with the general arrangement and specifications.
All dimensions in mm.
Do not scale from this drawing.


PLAN 1:20@A3

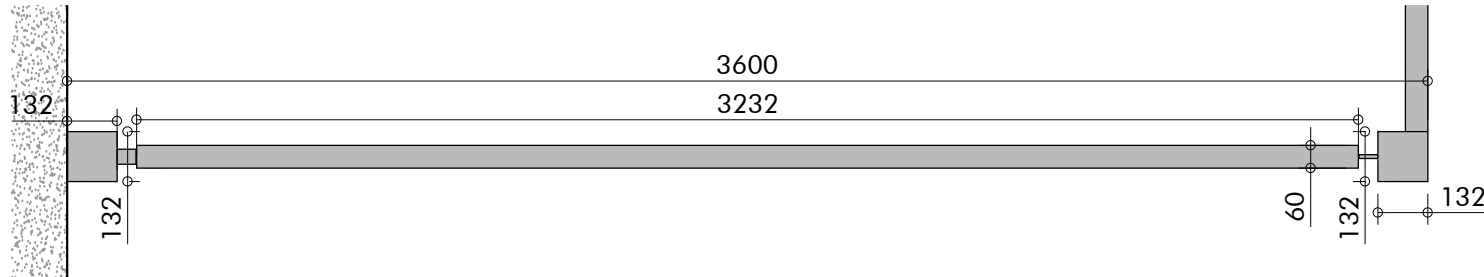


ELEVATION 1:20@A3

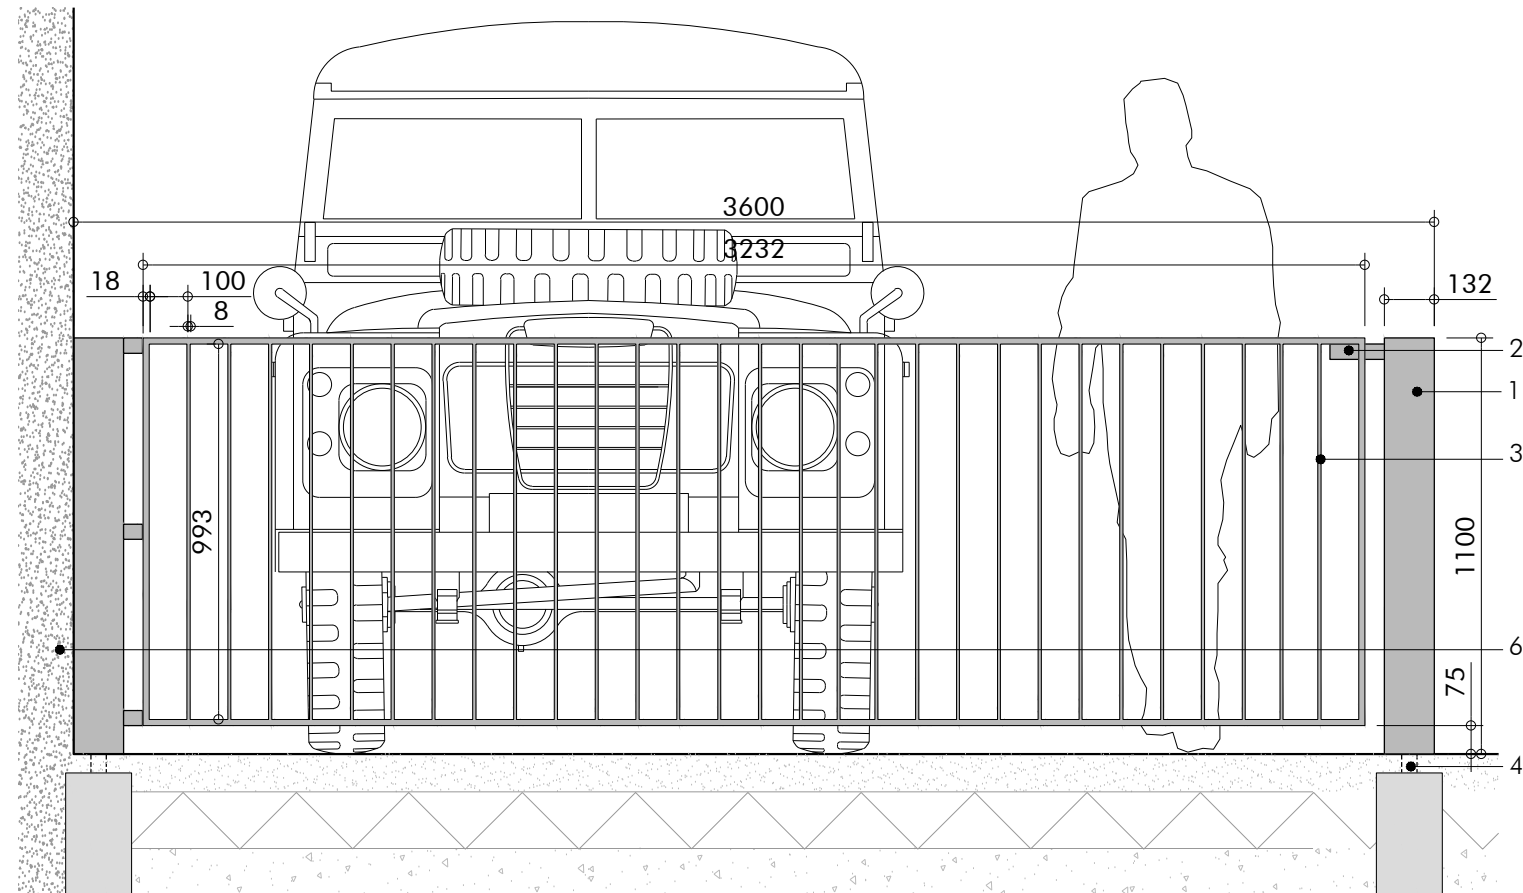

SIDE ELEVATION 1:20@A3

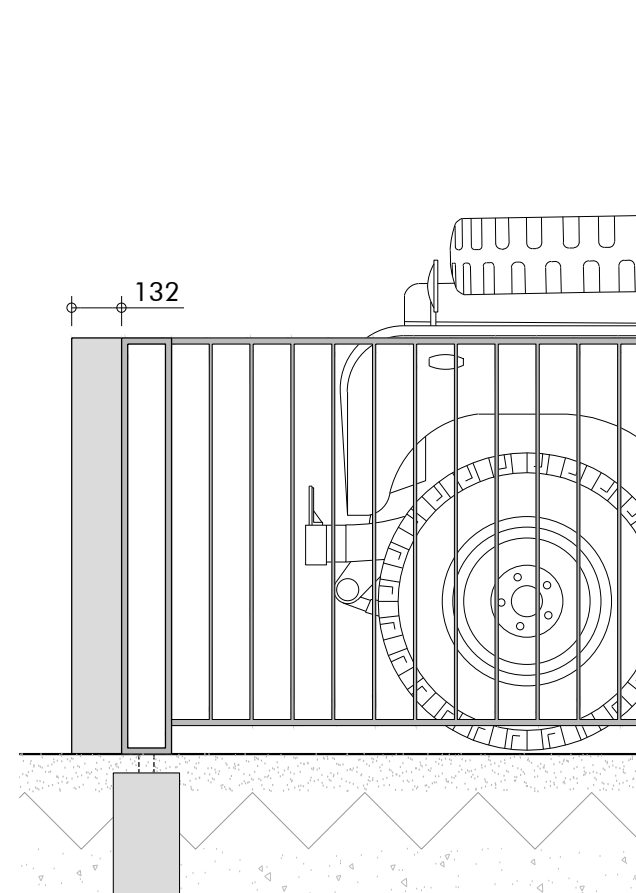

SECTION 1:20@A3

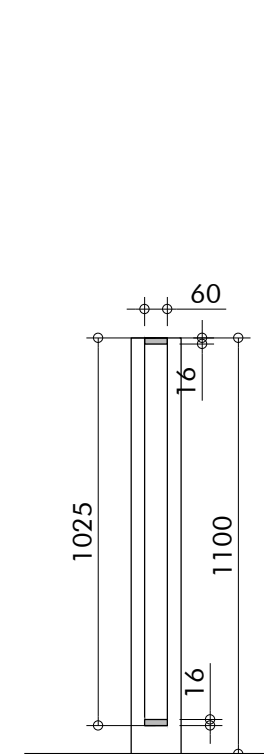

Revision	Description	Drawn by	Checked by	Date
-	Phase 1BN draft	JR	JP	04.08.16
A	Phase 1BN RMA Submission	JR	GG	03.03.17
B	Phase 1BN RMA Submission	JR	GG	23.03.17



project	Brent Cross Cricklewood Brent Riverside Park	drawn by	JR
status	Phase 1BN RMA Submission	checked by	JP
title	Typical Gate detail	date	02.08.16
Xref		scale	1:20@A3
drawing No	1065-03-457	revision	B

Macgregor ▪ Smith
Landscape Architecture

PLEASE SEE NOTES ATTACHED AT DRAWING NOTE Q1